


Via dello Scalo snc, 05026 Montecastrilli (TR)
0744/192.32.02 – 329/25.13.363
studiotecnico**cbf**@libero.it - **cbflaboratori**@pec.net
www.analischimiche**cbf**.it
P.IVA: 01463060556

CLIENT	PAOLINI SPA	
TYPE OF TEST	Bacteriology test on RIVA boat handle produced by ESI for RAZETO AND CASARETO	
REPORT OF SAMPLE NUMBER	UNI 10802 - sampling by client's technician	
COLLECTION: 29/04/20	RESULTS: 04/05/20	REGISTER NUMBER: R2004/068


TEST REPORT R2004 / 068

Bacteriological test on the handle (Photo 1) at time zero and on one hand.

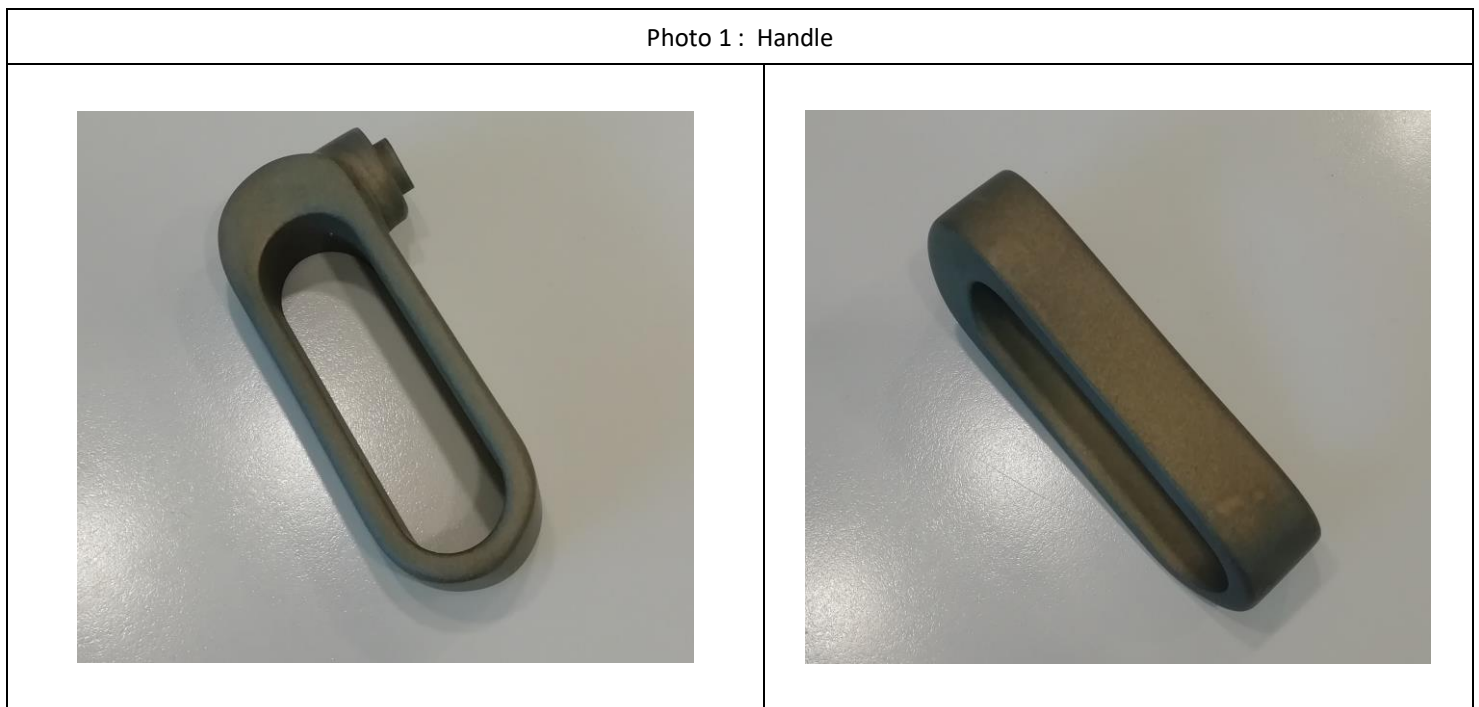

Once the absence of bacterial colonies on the handle and the presence of bacterial colonies on the hand had been confirmed, the hand held the handle for 15 seconds, after which a new bacteriological check was carried out, both on the handle and on the hand.

Via dello Scalo snc, 05026 Montecastrilli (TR)
 0744/192.32.02 – 329/25.13.363
 studiotecnicobf@libero.it - cbflaboratori@pec.net
 www.analischimichecbf.it
 P.IVA: 01463060556

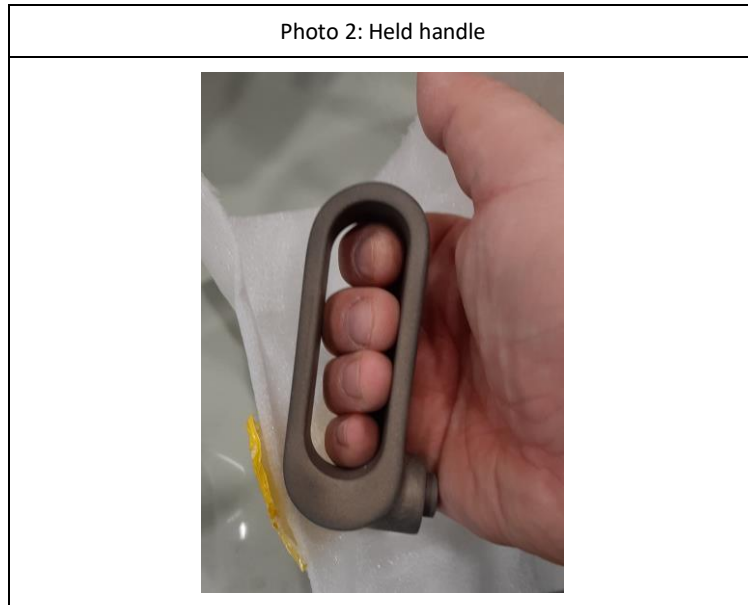

Results Obtained:

Initial Total Bacterial Count Method: ISO 18593:2004 + UNI ISO 4833	
Surface	Analysis Results
Handle	0 CFU/cm ²
Hand	37 CFU/cm ²

Total Bacterial Count after 15 seconds Method: ISO 18593:2004 + UNI ISO 4833	
Surface	Analysis Results

Via dello Scalo snc, 05026 Montecastrilli (TR)
0744/192.32.02 – 329/25.13.363
studiotecnico**cbf**@libero.it - **cbflaboratori**@pec.net
www.analischimiche**cbf**.it
P.IVA: 01463060556

Handle	0 CFU/cm ²
Hand	35 CFU/cm ²

Note:

- Instrumentation subject to prior calibration by: Instrument Service Srl, Torgiano (PG)
- Standards and reference materials Carlo Erba Reagenti S.r.l.
- UNI EN ISO 9001: 2015 certified laboratory.

COLLECTION: 27/04/20	RESPONSE: 04/05/20	REGISTER NUMBER: R2004/068
-----------------------------	---------------------------	-----------------------------------

CONCLUSIONS:

- 1- From the results obtained, it can be said that the ESI handle was not contaminated by the touch of the hand in the 15 seconds of contact.
- 2- The bacterial charge on the hand was reduced by the 15 seconds of contact with the ESI handle, of about 10%.

TECHNICIAN

Dr. Fabio Bassetti

Doctor of Chemical-Biological Analysis

[Valid in all respects by law pursuant to the Ministry of Health Decree No. 745 of 08/26/94, Art. 7 of Legislative Decree n.502 of 30/12/92, Art.6 paragraph 3 - R.D. n. 275 of 11/02/29, Art.16 and 18 - Recognition of the Ministry of Health of 12/30/98 Prot. N. 5005 / 50649 / 2989 - Cons. State # 5417 of 08/03/04 - ISO 9001: 2015]



Bassetti